


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

2X \varnothing .219
SECURE BARREL BOLT
OUTSIDE ENCLOSURE
WITH 2X 10-24 SCREWS
FROM INSIDE ENCLOSURE

6X \varnothing .219
SECURE WITH 6X 10-32
HEX HEAD BOLTS

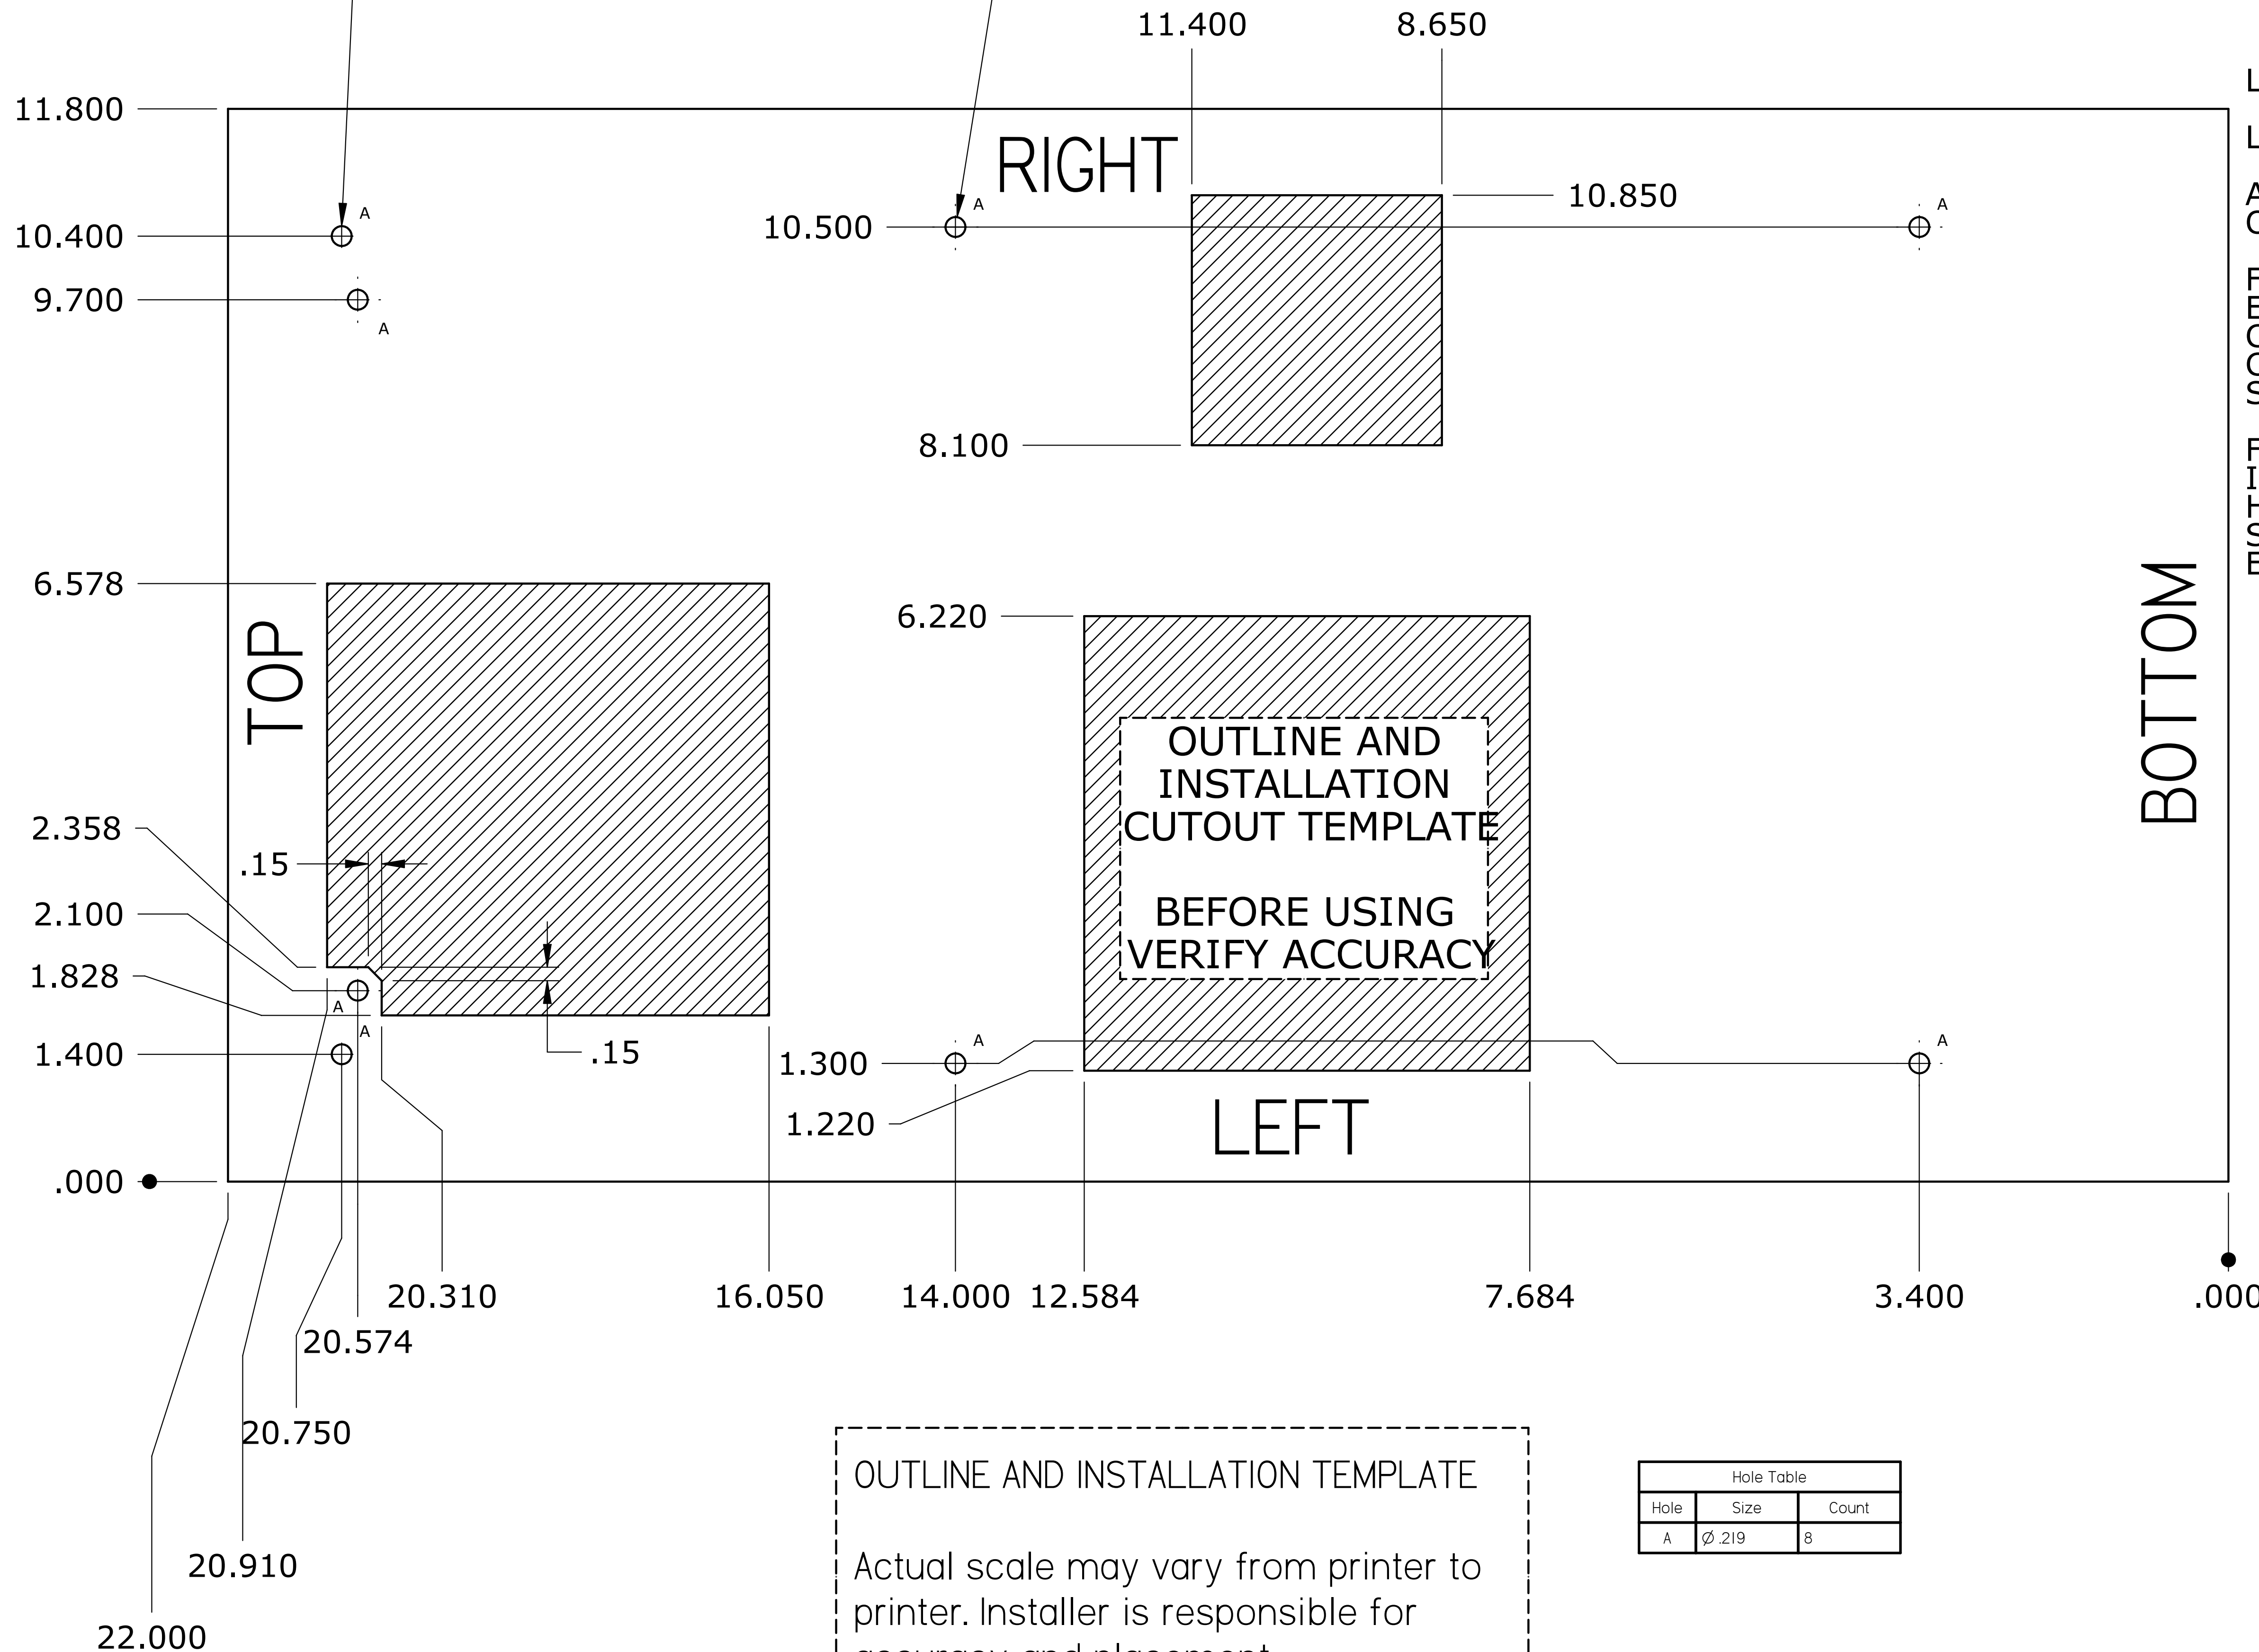

LOCATE DESIRED ELEVATION
LOCATE CUTOUTS AND HOLES
APPLY GASKET TO MOUNTING FACE
OF UNIT.
FASTEN 2 BARREL BOLTS OUTSIDE
ENCLOSURE AND HANG AIR
CONDITIONER BY THE AIR
CONDITIONER'S KEYHOLE
SLOTS AT THE TOP.
FASTEN AIR CONDITIONER FROM
INSIDE ENCLOSURE WITH 6 X 10-32
HEX HEAD BOLTS (1/2" LONG
SUPPLIED FOR UP TO 12 GA.
ENCLOSURES)

OUTLINE AND
INSTALLATION
CUTOUT TEMPLATE
BEFORE USING
VERIFY ACCURACY

OUTLINE AND INSTALLATION TEMPLATE
Actual scale may vary from printer to
printer. Installer is responsible for
accuracy and placement.

Hole Table		
Hole	Size	Count
A	\varnothing .219	8

NAME	DATE	TITLE	SCALE	WEIGHT	SHEET
atittle	03/13/08	INSTALLATION TEMPLATE NE015			1 OF 1
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES ±1° or 1 PL ±0.5° 2 PL ±0.02 3 PL ±0.010		SIZE D	DWG NO NE015 CUTOUT	REV	FILE NAME: tei_ne_010_cutout template.dft