


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

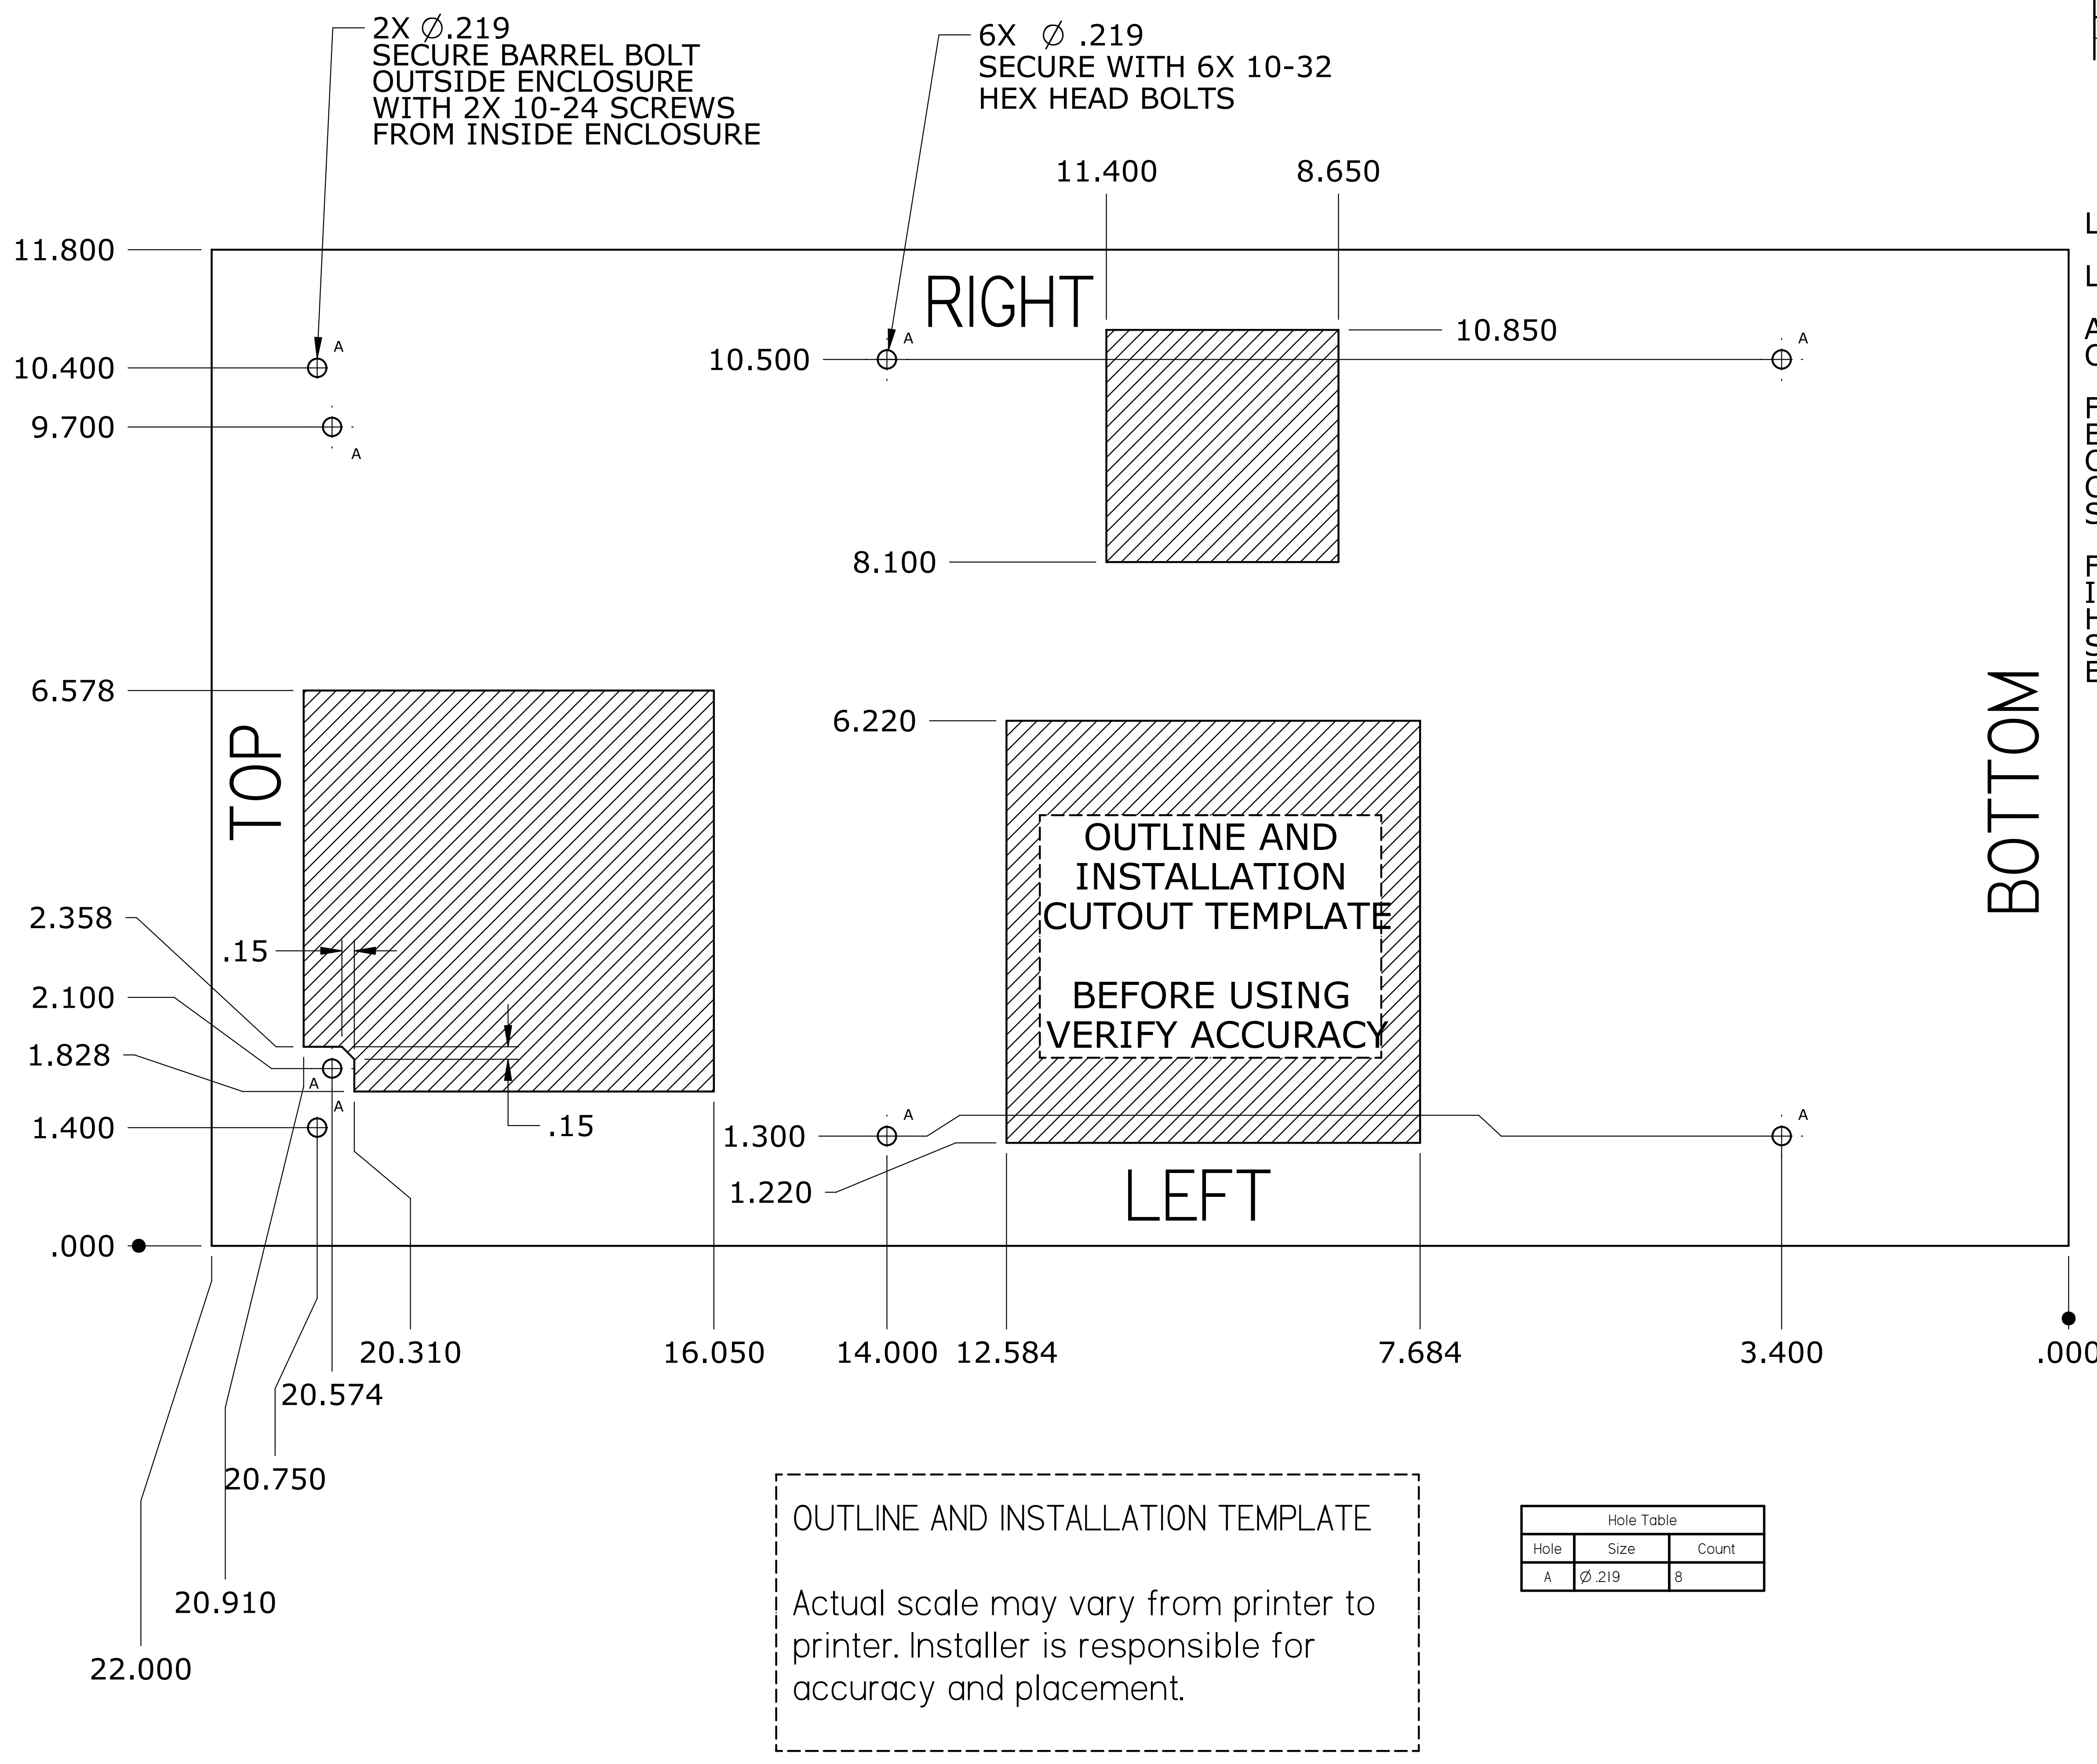

2X \varnothing .219
SECURE BARREL BOLT
OUTSIDE ENCLOSURE
WITH 2X 10-24 SCREWS
FROM INSIDE ENCLOSURE

6X \varnothing .219
SECURE WITH 6X 10-32
HEX HEAD BOLTS

LOCATE DESIRED ELEVATION
LOCATE CUTOUTS AND HOLES
APPLY GASKET TO MOUNTING FACE
OF UNIT.
FASTEN 2 BARREL BOLTS OUTSIDE
ENCLOSURE AND HANG AIR
CONDITIONER BY THE AIR
CONDITIONER'S KEYHOLE
SLOTS AT THE TOP.
FASTEN AIR CONDITIONER FROM
INSIDE ENCLOSURE WITH 6 X 10-32
HEX HEAD BOLTS (1/2" LONG
SUPPLIED FOR UP TO 12 GA.
ENCLOSURES)

Hole Table		
Hole	Size	Count
A	\varnothing .219	8

OUTLINE AND INSTALLATION TEMPLATE
Actual scale may vary from printer to
printer. Installer is responsible for
accuracy and placement.

NAME	DATE	TITLE	SIZE	DWG NO	REV
atittle	03/13/08	INSTALLATION TEMPLATE NE015	D	NE015 CUTOUT	
CHECKED					
ENG APPR					
MGR APPR					
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES ±1° or 1 PL ±0.5° 2 PL ±0.02 3 PL ±0.010			SCALE:	WEIGHT:	SHEET 1 OF 1